


**FIGURE 1**

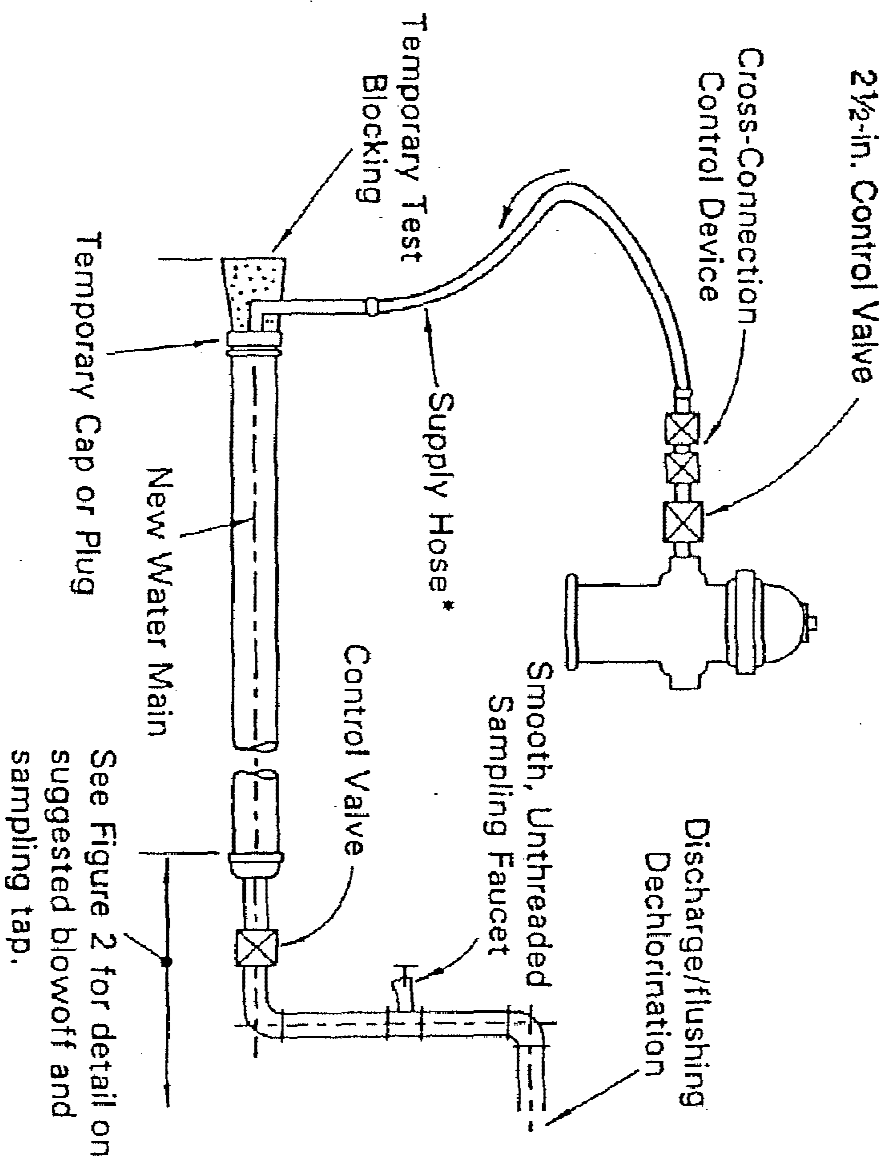

\*Clean potable-water hose only.  
hydrostatic pressure test.

NOTE: Figure 1 applies to pipes with diameters 4 in. (100 mm) through 12 in. (300 mm). Larger sizes must be handled on a case-by-case basis.

This hose must be removed during the

# TEMPORARY FLUSHING/TESTING CONNECTION